


PFISTERER

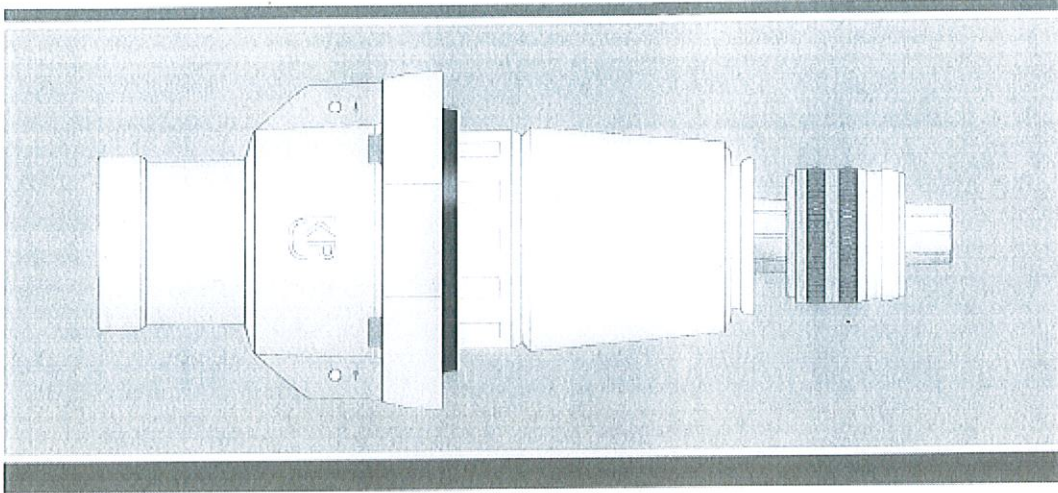

HV-CONNEX 4

ASSEMBLY INSTRUCTION HV GIS and Transformer Cable Connector up to $U_m = 72.5$ kV

Note: The installation instructions and the packing list are order specific

ENDORSED BY	SIGNATURE	DATE
Wilfred Leung Principal Engineer Mains RailCorp	<i>W. Leung</i>	4. 4. 2013

APPROVED BY	SIGNATURE	DATE
Neal Hook Chief Engineer Electrical RailCorp	<i>N. Hook</i>	8/4/2013